


Ludlow, MA - Riverside Drive Addendum - 03

Addendum – 03 is complete and being uploaded to the Wright-Pierce projects website at this time. Due to the file size, the PDF was not attach it to this email.

The link below will be updated shortly with the Addendum – 03 folder.

<https://www.wrightpierceanroom.com/jobs/694/addenda/ludlow-ma-riverside-dr-associated-infrastructure-improvements>

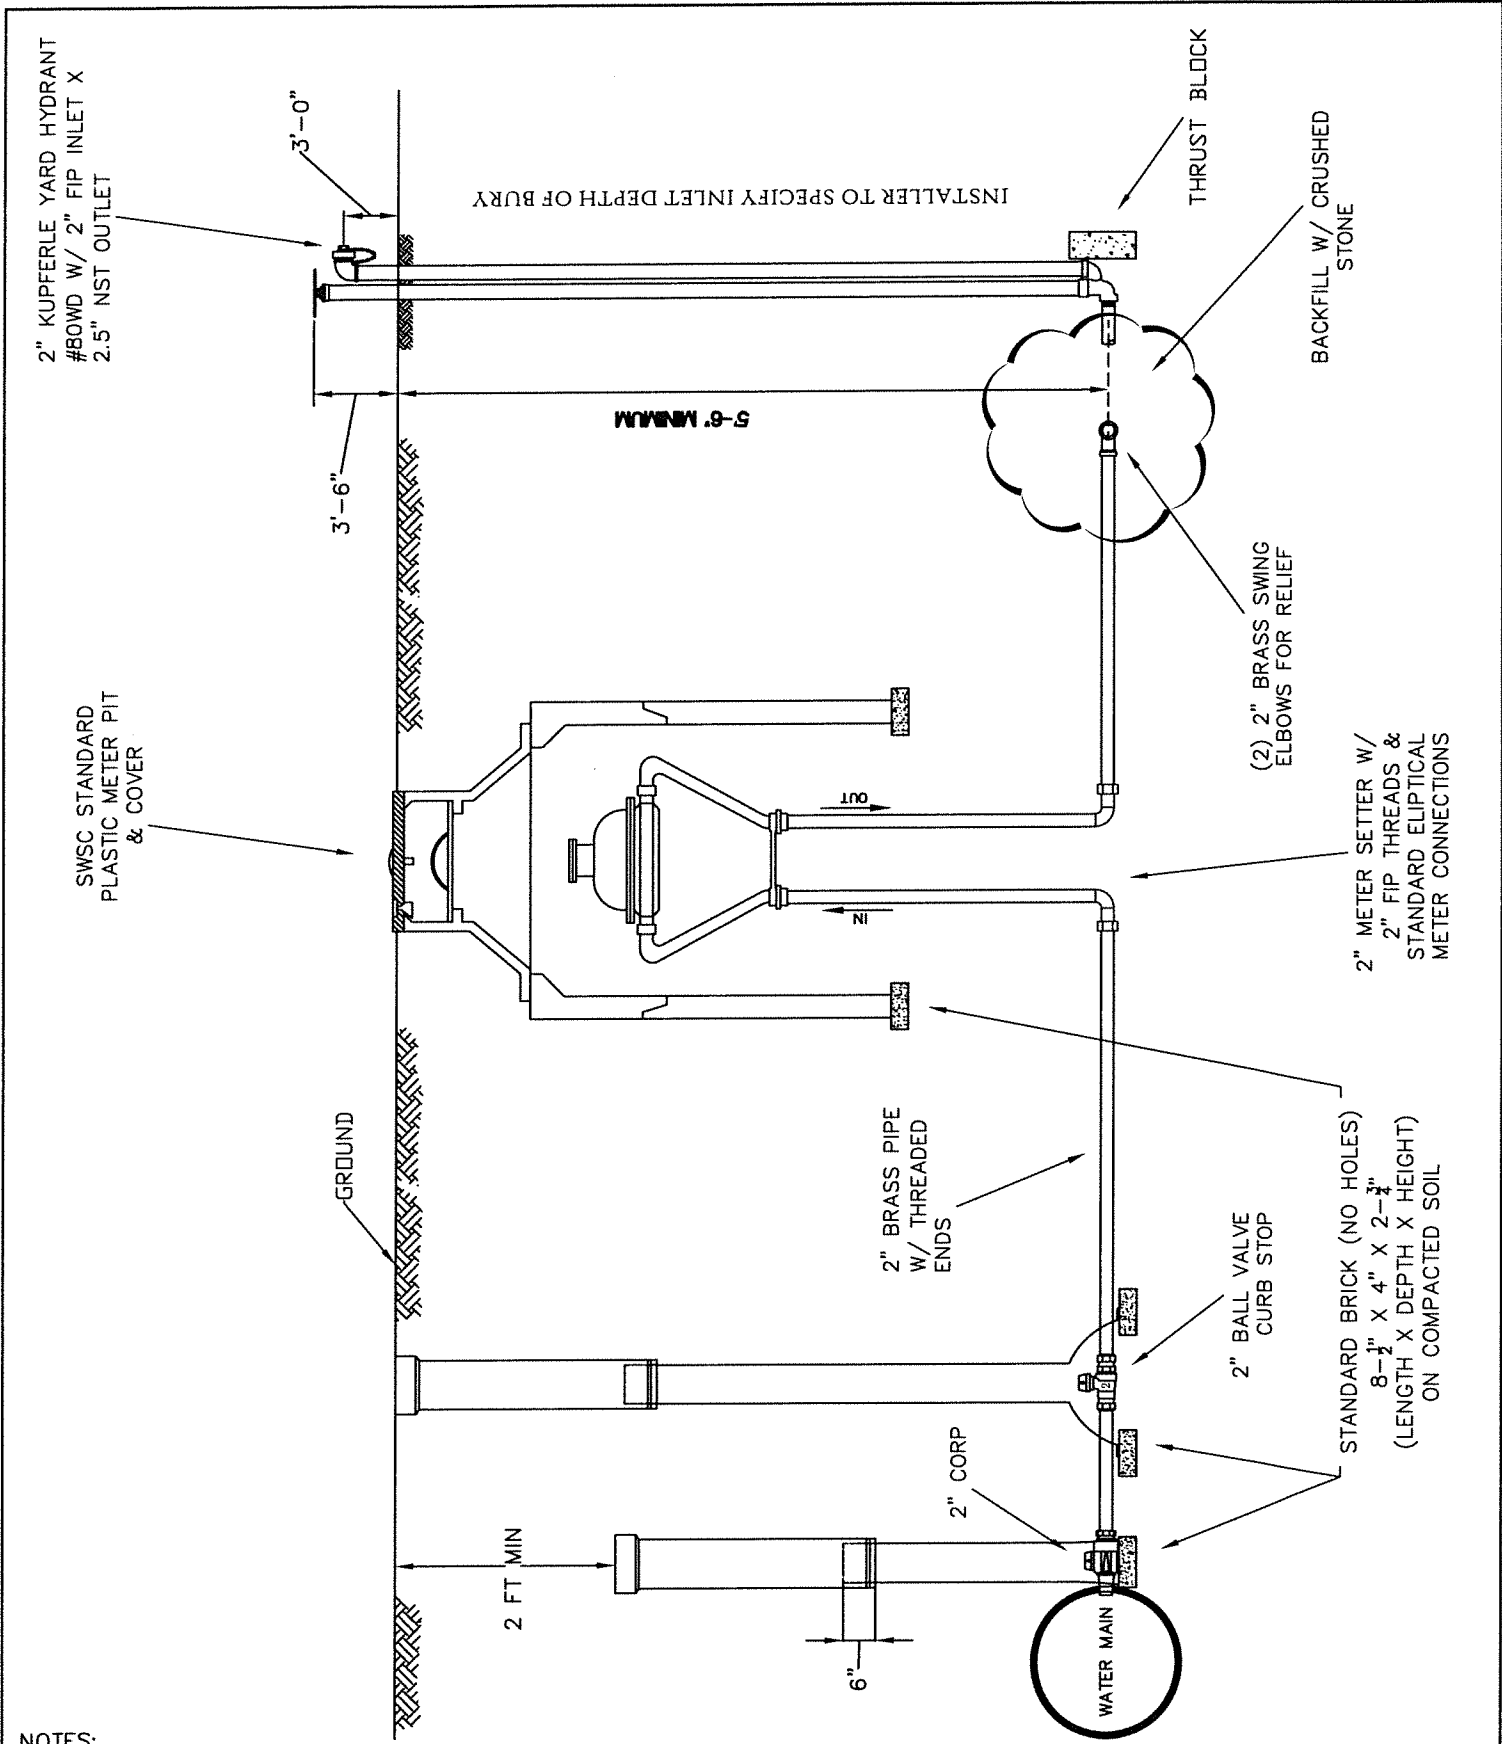

NOTES:

1. ALL MATERIALS AND INSTALLATION PROCEDURES SHALL CONFORM TO SWSC MATERIAL SPECIFICATIONS AND GUIDELINES & POLICIES.
2. ALL 2-INCH PIPING SHALL BE THREADED BRASS.
3. VALVE BOX AND METER PIT SHALL BE SUPPORTED USING BLOCKS.

SPRINGFIELD WATER AND SEWER COMMISSION		
	WATER DETAIL W-11.5	REV. DATE
	<i>TYPICAL YARD HYDRANT</i>	
SCALE: NTS		10/27/20 M.J.